


ABOVE GROUND CYLINDER INSTALLATION

Federal, state, and local ordinances and regulations should be observed at all times.

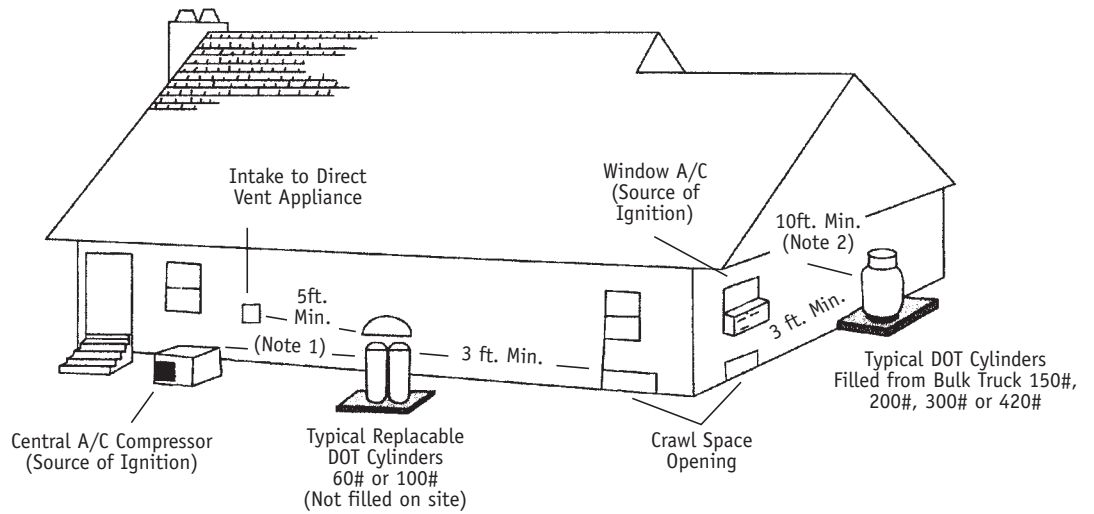

Notes:

1. 5 foot minimum between relief valve discharge and external source of ignition (air conditioner), direct vent, or mechanical ventilation system (attic fan).
2. If the DOT cylinder is filled on-site from a bulk truck, the filling connection and vent valve must be at least 10 feet from any external source of ignition, direct vent, or mechanical ventilation system.

AmeriGas[®]
America's Propane Company